


Part #: 410367

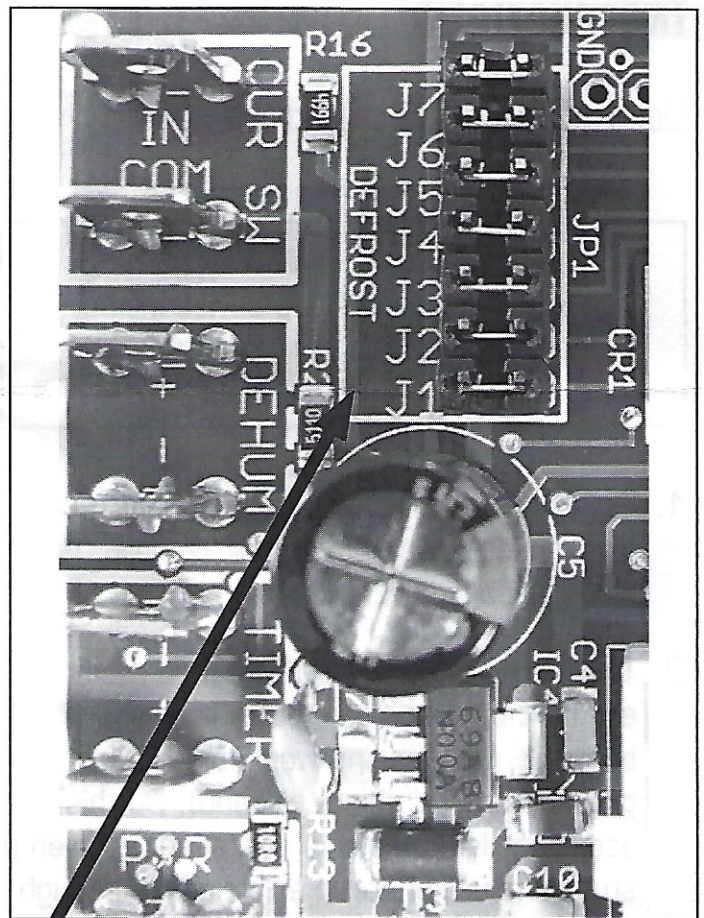

Part #: 412850

Attention

Please make sure the jumpers position on your new replacement board are set exactly the same as the board in your unit as indicated on the wiring diagram located in the cover of the electrical box.

If you have any questions, please contact our customer support department at 1.800.565.3548 or by email at: support@fantech.ca

Assurez-vous que la position des connections sur la nouvelle carte électrique est la même que sur la carte existante de votre unité tel qu'indiqué sur le diagramme électrique posé dans le couvert du boîtier électrique.

Si vous avez des questions, s'il vous plaît contacter notre service d'assistance à la clientèle au 1.800.565.3548 ou par courriel à: support@fantech.ca

INSTRUCTIONS

Uni-Control Board Replacement

WARNING

Static-electric sensitive device inside.
Please handle with care and follow the following directions:

1. Prepare HRV for board replacement (i.e. disconnect power, open door, remove electrical box cover).
2. Touch a grounded metal object to drain any built-up static electricity from your body (i.e. HRV casing would be the best grounded metal object at hand). Do this occasionally during this operation, as even a small amount of static electricity is enough to damage the electronic board.
3. Avoid any excessive movements, especially walking, as this will create more static electricity.
4. Remove NEW electronic board from anti-static bag.
5. Replace OLD board with NEW being careful to replace jumpers in the appropriate locations. (See illustrations)
6. Insert OLD board in anti-static bag and return to manufacturer if requested to do so.
7. Install electrical box cover, close door and re-initiate power to unit.

INSTRUCTIONS

Remplacement du Panneau de Commande Électronique

ATTENTION

Dispositif sensible au statique-électrique à l'intérieur. Manipulez avec soin et suivez les instructions suivantes :

1. Préparez l'unité de ventilation pour le remplacement du panneau (c.-à-d: débrancher le fils d'alimentation, ouvrir la porte, retirer la couverture électrique).
2. Touche un objet métallique mise-à-terre pour évacuer toute électricité statique de votre corps (c.-à-d. l'enveloppe de ventilateur serait le meilleur objet mise-à-terre a votre disposition). Faites ceci de temps en temps pendant cette exécution, comme même un peu de l'électricité statique est assez pour endommager le panneau électronique.
3. Évitez tous mouvements excessifs, marchant particulièrement, car ceci créera l'électricité statique.
4. Retirez le NOUVEAU panneau électronique du sac antistatique.
5. Remplacez le VIEUX panneau avec NOUVEAU faisant attention à substituer les connexions dans les emplacements appropriés. (Voir illustration)
6. Retournez le VIEUX panneau électronique dans le sac antistatique et le retourner au fabricant si demandé.
7. Ré-installez la couverture électrique, la porte et re-brancher le fils d'alimentation.